




**BEMAC LABORATORIES**

A Subsidiary of Mahaffey Associates Pty Ltd ACN 001 629 036  
4 Mary Parade (PO Box 349) Rydalmere BC NSW 1701  
Phone: 9684 2422 Fax: 9684 2310  
Email: mahaffey@mahaffey.com.au



This Laboratory is accredited by the National Association of Testing Authorities, Australia. The tests reported herein have been performed in accordance with its terms of accreditation.

Client: Drytreat  
Site: Laboratory  
Material Tested: 400 X 400 exposed aggregate pavers  
Test Method: AS 3661 App A: Method for the measurement of the coefficient of friction of wet surfaces  
Weather Condition: Not Applicable  
Test Date: 10/ 11/ 2000

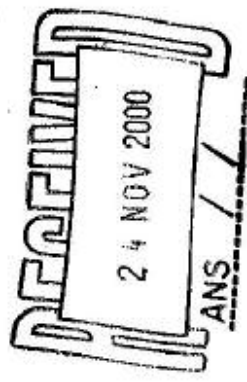

Test No.	Sample Description	Air Temp (deg C)	Slope (in dirn of test) (%)	Mean Test Result	
				Pendulum No.	Coeff of Friction
1	Paver Seal	23	0.0	53	0.58
2	Stain Proof	23	0.0	66	0.76
3	No Coating	23	0.0	68	0.79
4	Oil Repeller	23	0.0	64	0.73

- Notes:
- ▶ Samples tested using 4S Slider
  - ▶ Samples wiped to remove dust, otherwise tested as received

Signed: *David Wilms*  
David Wilms